All dimming ballasts to be Lutron EcoSystem, Hi-Lume or Ecc-10 type.

E.E. to confirm all circuiting requirements.

Architect to verify quantity, location & finish of all controls.

All faceplates, dimmers, switches, receptacles & cable/phone jacks to be Lutron NOVA T*.

Lutron Field Service commissioning included in all systems initiates an 8 year limited warranty. The electrical contractor must contact Lutron (800-523-9466) to set up visit with 10 days notice.

WIRING SYMBOLS

Δ Lutron cable GRX-CBL-46L (5 Conductor Non-Plenum) or GRX-PCBL-46L (5 Conductor Plenum rated). Otherwise use 2 #12AWG (2.5mm²), 1 Belden #9461, and between panels add 1 #18AWG (1.0mm²) for emergency sensing.

○ Sivoia link requires Lutron cable SVQ-CBL-250 or 2 #16(Power), 1 #18 (Gnd) plus 4 #18 Twisted and Shielded.

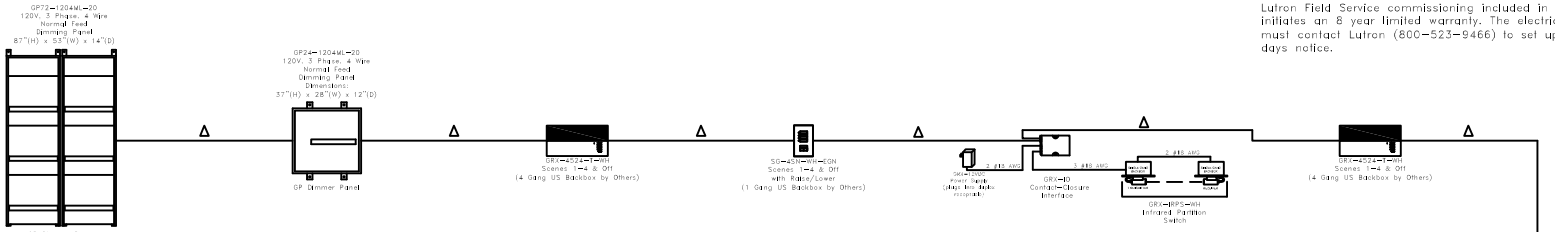

(Shades and Shade Power Panels to be provided by Window Treatment Dealer)

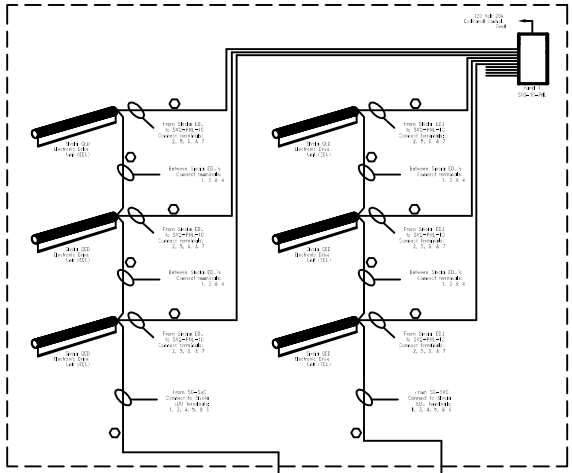



GRAFIK Eye 4000 System

CONCEPT DRAWING
NOT FOR CONSTRUCTION

Project Number:	X
Drawn By:	X
Drawing Revision:	X
Drawing Date:	X
Sheet:	X

LUTRON.
Lutron Electronics Co., Inc.
7200 Suter Road | Coopersburg, PA 18036 | USA
(610) 282-3800 | fax (610) 282-1146