


A Lutron and its subsidiaries, its affiliates, subsidiaries, agents, representatives, contractors, and other personnel shall not be held responsible for any errors or omissions in this drawing.

B Lutron is not responsible for any errors or omissions in this drawing.

C Lutron is not responsible for any errors or omissions in this drawing.

D Lutron is not responsible for any errors or omissions in this drawing.

All dimming ballasts to be Lutron EcoSystem, Hi-Lume or Eco-10 type.
 E.E. to confirm all circuiting requirements.
 Architect to verify quantity, location & finish of all controls.
 All facelifts, dimmers, switches, receptacles & cable/phone jacks to be Lutron NOVA T4.
 Lutron Field Service commissioning included in all systems initiates an 8 year limited warranty. The electrical contractor must contact Lutron (800-523-9466) to set up visit with 10 days notice.

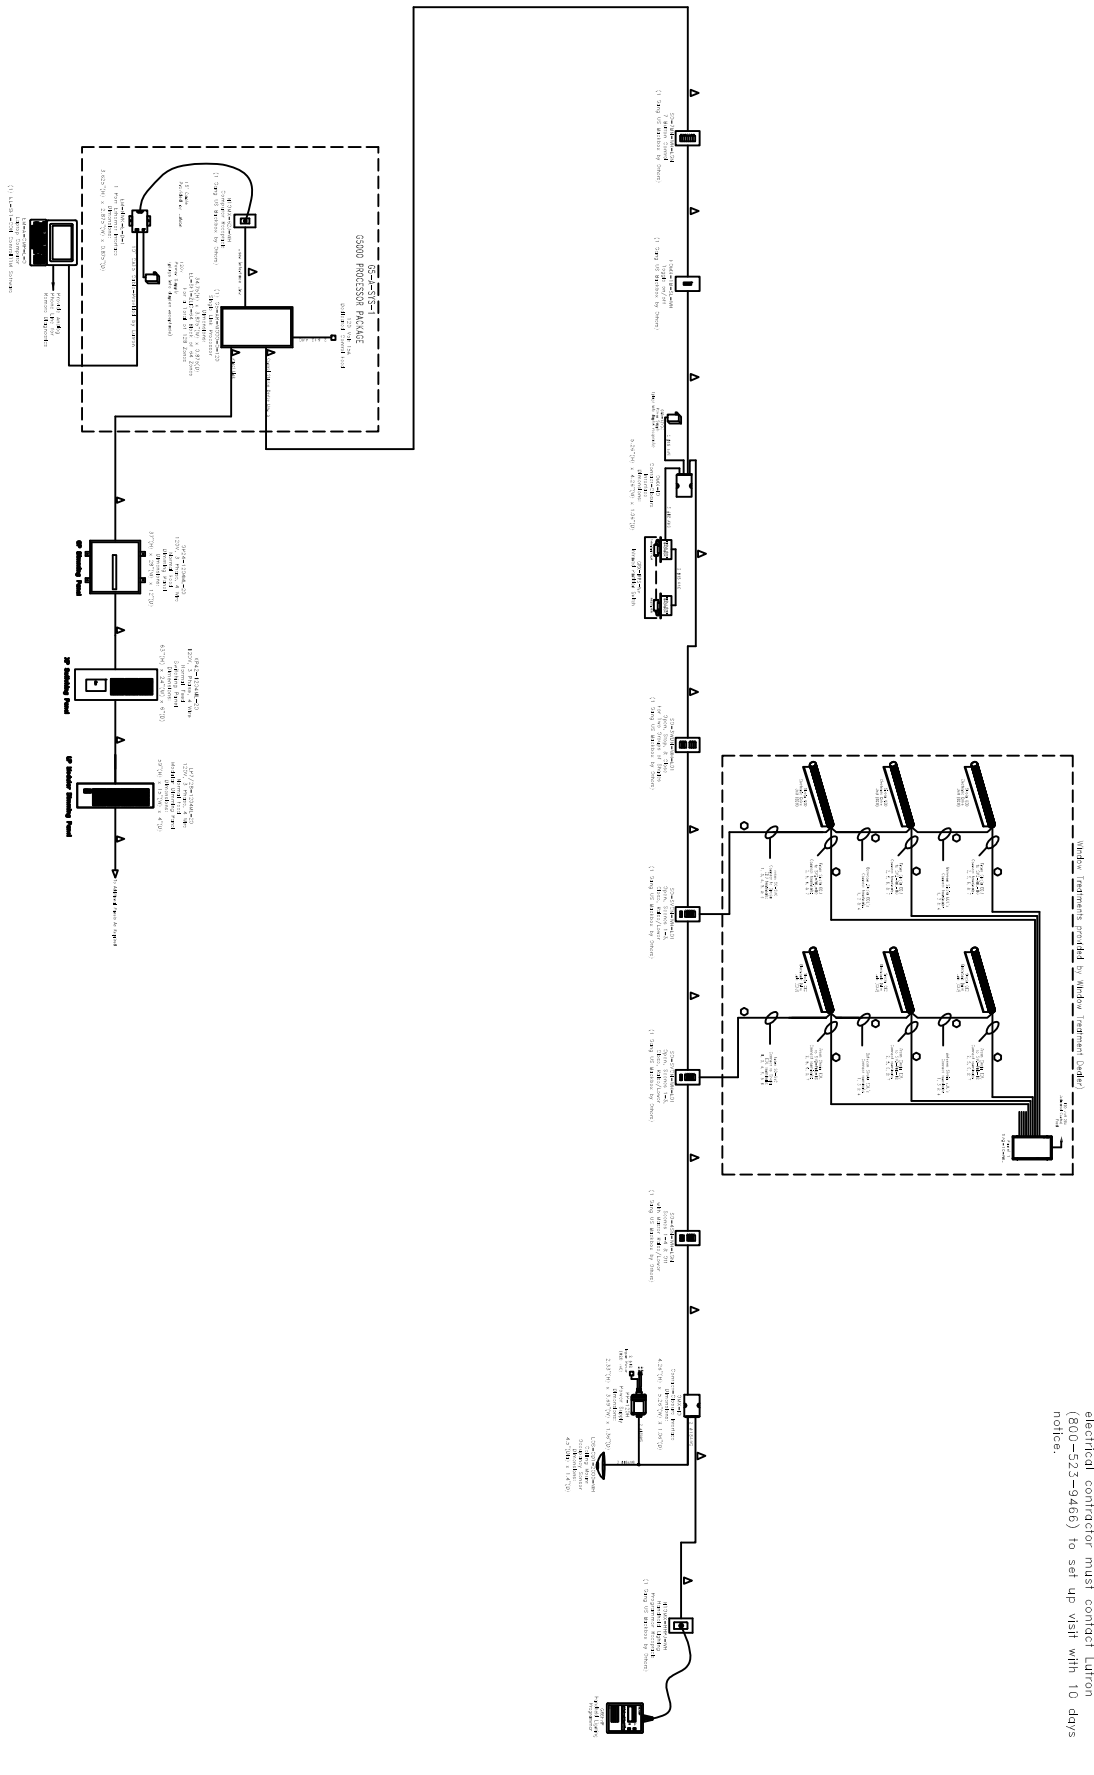

GRAFIK 5000
Typical System

CONCEPT DRAWING
 NOT FOR CONSTRUCTION

Project Number:	X
Design By:	Y
Designing Engineer:	X
Designing Date:	X
Drawn:	X
Checked:	X

