

All dimming ballasts to be Lutron EcoSystem, Hi-Lume or Eco-10 type.


E.E. to confirm all circuiting requirements.

Architect to verify quantity, location & finish of all controls.

All faceplates, dimmers, switches, receptacles & cable/phone jacks to be Lutron NOVA™.

Lutron Field Service commissioning included in all systems initiates an 8 year limited warranty. The electrical contractor must contact Lutron (800-523-9466) to set up visit with 10 days notice.

- WIRING NOTES:**
- 2 #12AWG (2.5 mm²)
 - 5 #12AWG (2.5 mm²)
 - 120V Input Power
 - ▲ Lutron cable GRX-CBL-346S (4 Conductor Non-Plenum) or GRX-PCL-346S (4 Conductor Plenum rated). Otherwise use 2 #18AWG (1.0mm²) and 1 Belden #9461.
 - ES EcoSystem bulk requires Lutron cable C-CBL-216-08-1 (2 #16 Conductor Non-Plenum) or C-CBL-216-CL-1 (2 #16 Conductor Plenum rated). Otherwise use 2 #16AWG by others.
- ⚡ Indicates presence of radio frequency transmission.

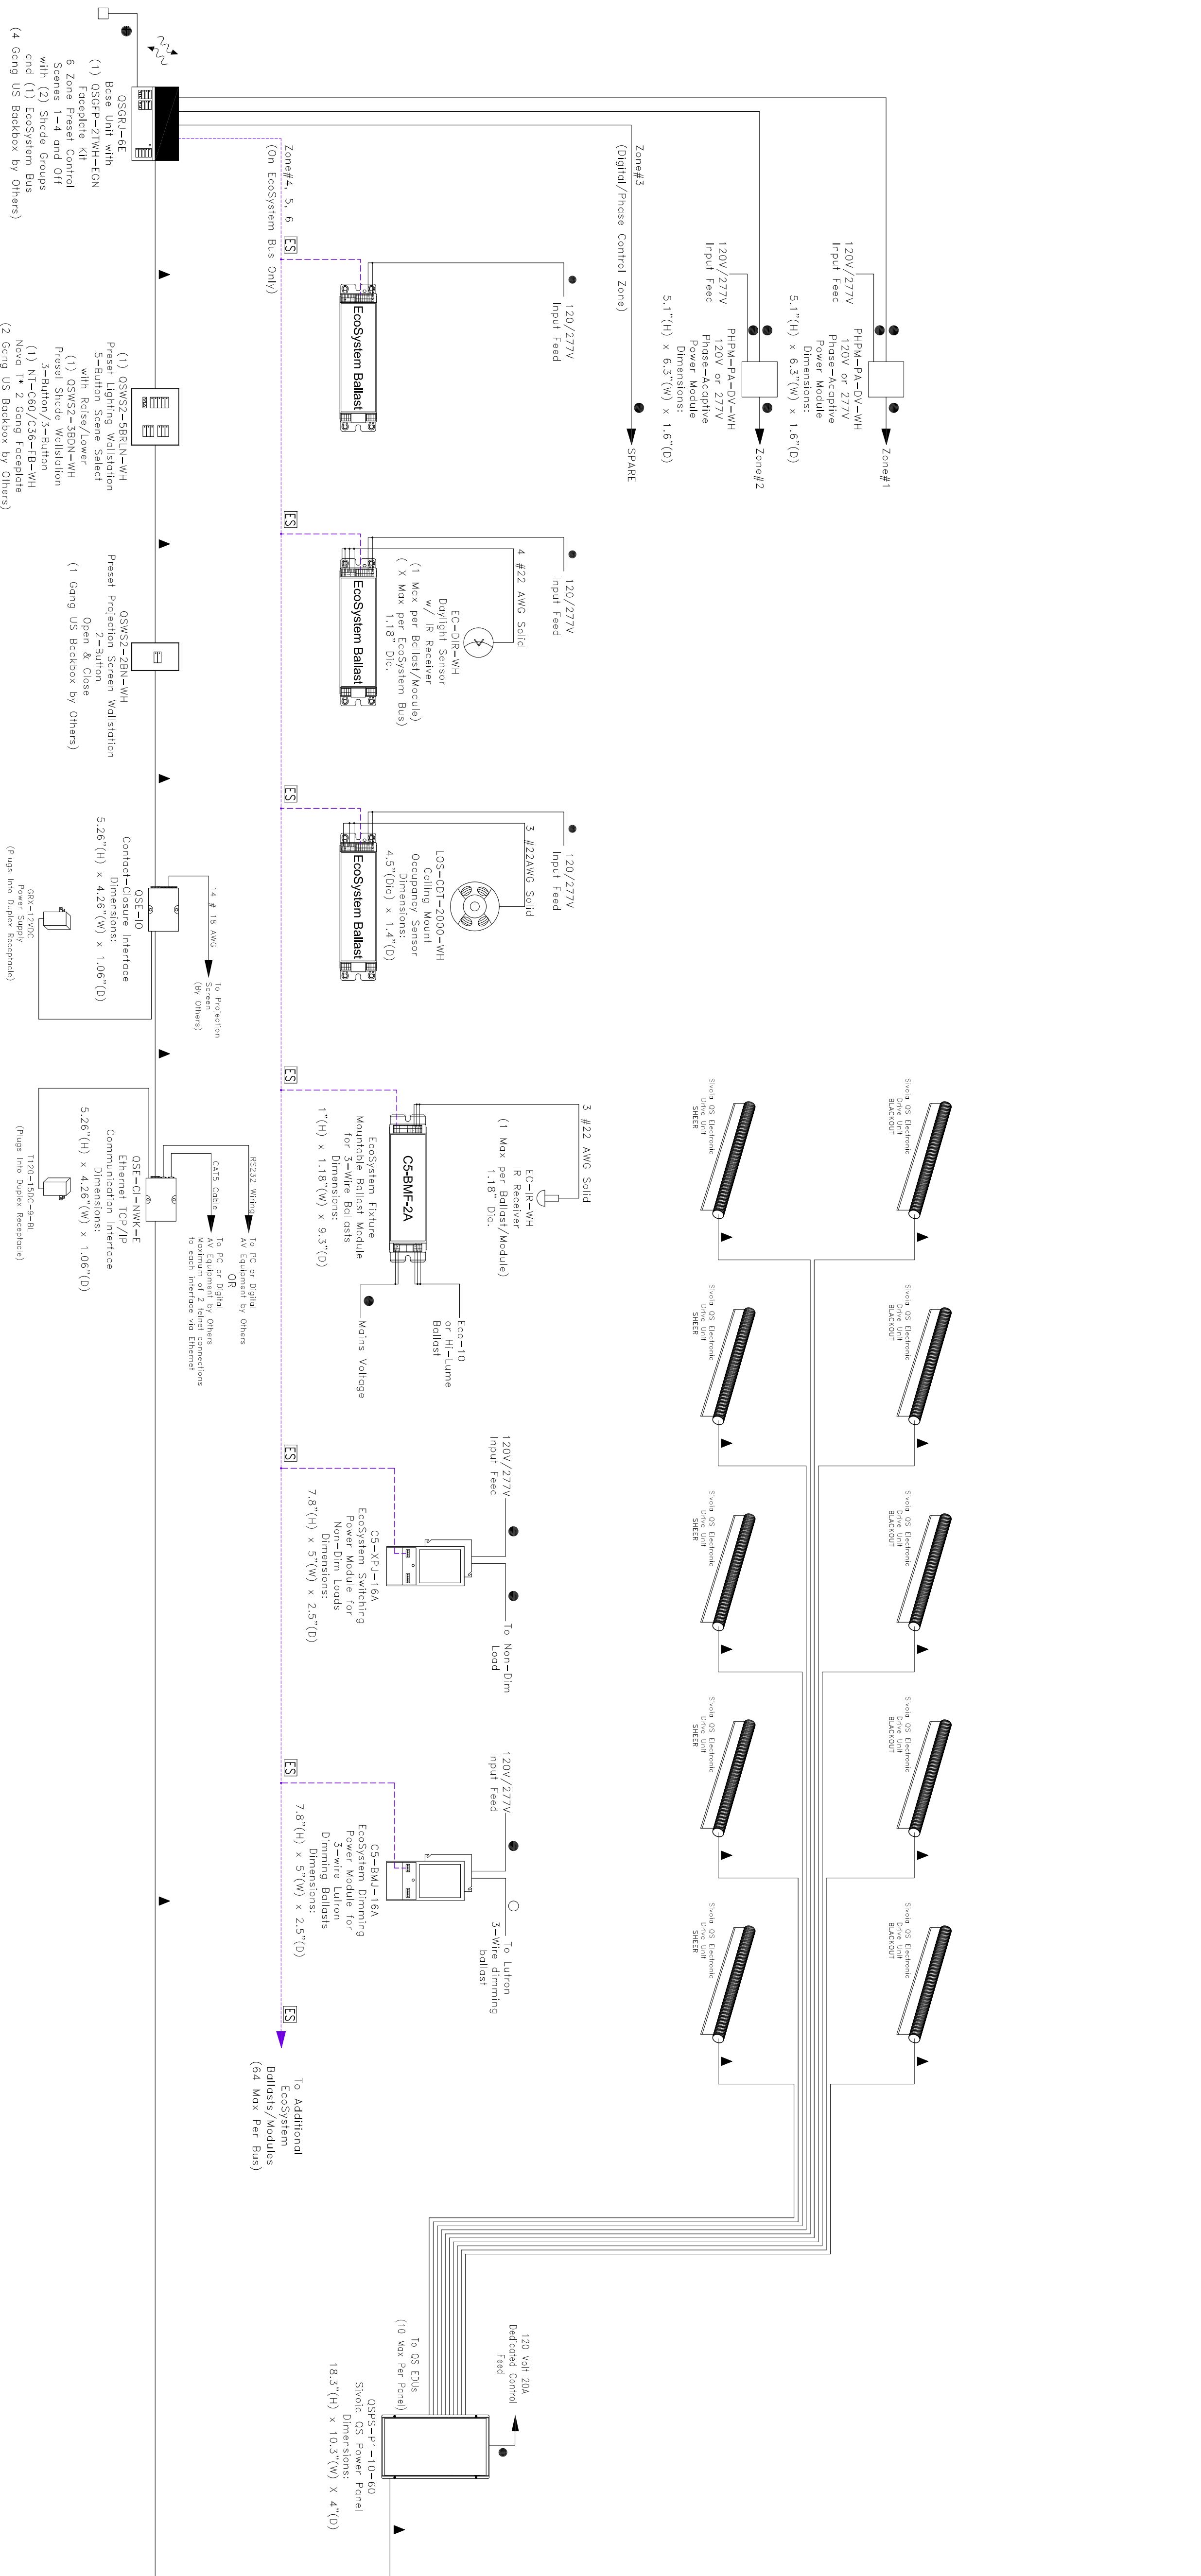

GRAFIK Eye QS with EcoSystem & Shades Typical System

CONCEPT DRAWING
NOT FOR CONSTRUCTION

Project Number:	X
Drawn By:	X
Drawing Revision:	X
Drawing Date:	X
Sheet:	X