


WIRING SYMBOLS

△ Lutron cable GRX-CBL-46L (5 Conductor Non-Plenum) or GRX-PCBL-46L (5 Conductor Plenum rated). Otherwise use 2 #12AWG (2.5mm²), 1 Belden #9461, and between panels add 1 #18AWG (1.0mm²) for emergency sensing.

All dimming ballasts to be Lutron EcoSystem, Hi-Lume or Eco-10 type.
 E.E. to confirm all circuiting requirements.
 Architect to verify quantity, location & finish of all controls.
 All faceplates, dimmers, switches, receptacles & cable/phone jacks to be Lutron NOVA T*.
 Lutron Field Service commissioning included in all systems initiates an 8 year limited warranty. The electrical contractor must contact Lutron (800-523-9466) to set up visit with 10 days notice.

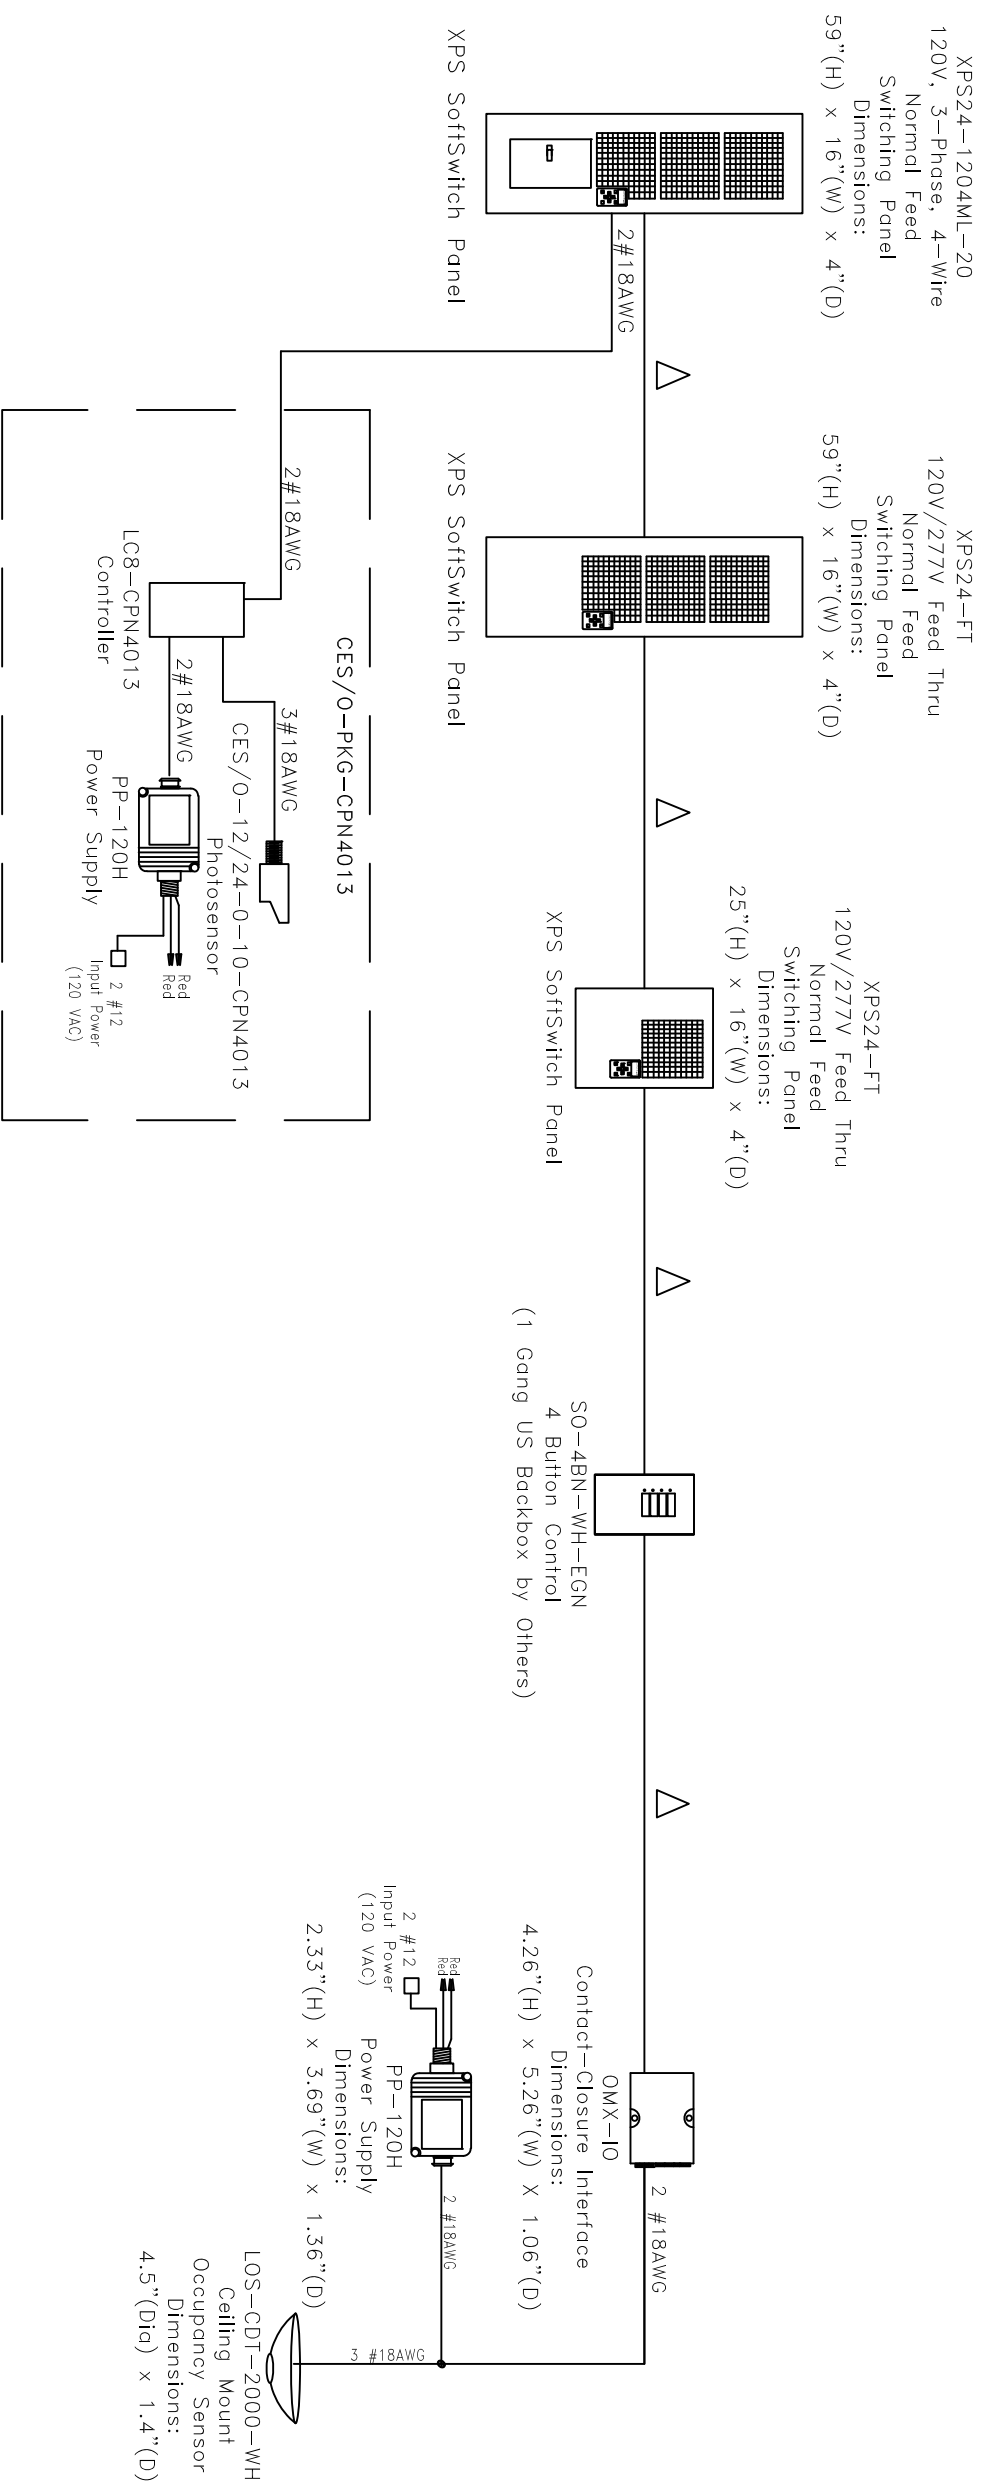

Typical XPS Switching System

**ONLINE DIAGRAM
 CONCEPT ONLY
 NOT FOR CONSTRUCTION**

Project Number:	X
Drawn By:	X
Drawing Revision:	X
Drawing Date:	X
Sheet:	X