



28 OUTPUT SWITCH PANEL  
 XPS28-1204ML-20  
 NORMAL FEED TYPE  
 (for 277V, change 120 to 277)

△ Control link requires Lutron All-in one cable  
 GRX-CBL-46L-500 (5 Conductor) or  
 2 #12 (class 2) plus one  
 Belden #9461 or Alpha #2211 cable.

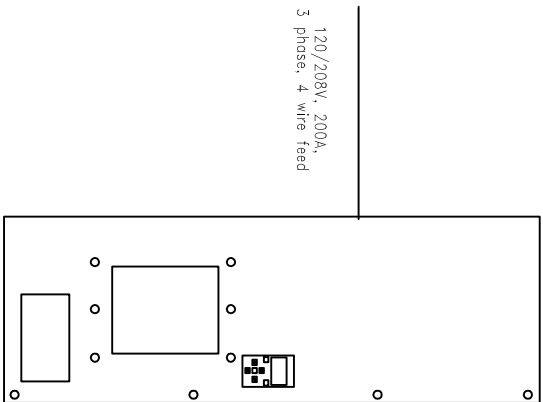

PANEL DIMENSIONS:  
 59.50"(H)X14.375"(W)X4.21"(D)

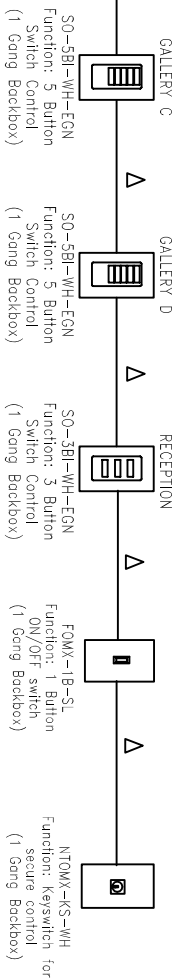

NOTES:

NOTES:

- 1) PANEL HAS BUILT-IN PROCESSOR AND ASTRONOMIC TIME CLOCK. UP TO 500 EVENTS CAN BE PROGRAMMED WITHIN A CALENDAR YEAR ON A WEEKLY SCHEDULE AND FOR UP TO 40 HOLIDAYS.
- 2) SYSTEM IS PROGRAMMED FROM LCD SCREEN LOCATED DIRECTLY ON PANEL. CONTROLS CAN BE PROGRAMMED FOR AREA CONTROL, MANUAL OVERRIDE, DELAY TO OFF, RECALL LIGHT PATTERNS, OR TIME CLOCK ENABLE/DISABLE TO BE DETERMINED IN THE FIELD.
- 3) PANEL PROCESSOR SHALL BE PASSWORD PROTECTABLE FOR SECURITY.
- 4) ALL INPUT FEED, LOAD, AND CONTROL TERMINALS SHALL BE FRONT ACCESSIBLE WITHOUT THE NEED TO REMOVE RELAY ASSEMBLIES OR OTHER COMPONENTS.
- 5) THE CONTROL SYSTEM SHALL HAVE A FULL INTERNAL BATTERY BACKUP THAT CAN STORE ALL SYSTEM MEMORY FOR ONE YEAR WITHOUT POWER.
- 6) PANEL SHALL BE RECESS OR WALL MOUNTED.
- 7) PANEL AND OTHER SYSTEM COMPONENTS INCLUDING CONTROL STATIONS AND WIRING SHALL BE U.L. APPROVED AND SHALL ALSO BE APPROVED BY ALL LOCAL AUTHORITIES HAVING JURISDICTION.
- 8) PANEL AND CONTROLS SHALL BE MANUFACTURED BY LUTRON.
- 9) PANEL SHALL BE FACTORY PRE-ASSEMBLED AND 100% TESTED PRIOR TO SHIPMENT.
- 10) MANUFACTURER SHALL PROVIDE TOLL-FREE TECHNICAL SUPPORT HOTLINE 24 HOURS PER DAY, 7 DAYS PER WEEK.
- 11) WIRING FROM THE PROCESSOR TO CONTROL WALLSTATIONS AND CONTROL INTERFACES SHALL BE LOW VOLTAGE TYPE CLASS 2 WIRING (PLV).
- 12) PANEL HAS TWO CONTACT CLOSURE INPUTS FOR BMS INTEGRATION, OCCUPANCY SENSOR, OR PHOTO SENSOR INPUTS.
- 13) BRANCH CIRCUIT BREAKERS SHALL HAVE THE FOLLOWING CHARACTERISTICS: THERMAL-MAGNETIC, SWD RATED, 10,000 AIC, AND CONTAIN A VISUAL TRIP INDICATOR.



COOPERSBURG, PA 18036  
 PHONE: (610) 282-3800  
 FAX: (610) 282-1146

Project Name:	SAMPLE Softswitch128 System with Standard Panel
Location:	X
Drawn By:	X
Date:	X
Job Number:	X
Drawing:	X
Sheet:	X